




## Push-button interface plus

### Operating instructions

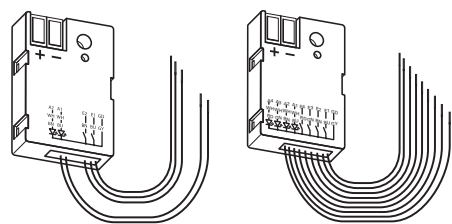

**Push-button interface 2-gang plus**  
Art. no. MTN670802



**Push-button interface 4-gang plus**  
Art. no. MTN670804

### For your safety



#### DANGER

##### Risk of fatal injury from electrical current.

All work on the device should only be carried out by trained and skilled electricians. The country-specific regulations and the valid KNX guidelines must be followed.




#### CAUTION

##### The device could become damaged.

- Only operate the device according to the specifications stated in the Technical data.
- High voltages can cause damage. Never connect the device to 230 V!

## Operating and display elements




- Ⓐ Bus connection
- Ⓑ Programming button
- Ⓒ Programming LED

## Push-button interface installation

- Mount the push-button interface in
  - a flush-mounted box at least 40 mm deep,
  - a cavity wall installation box ( $\varnothing = 60$  mm),
  - a junction box.
- Connect inputs to a floating push-button or switch (see connection example).
- Connect outputs to control lamps (low-current LEDs) in the push-button or switch (see connection example).

Connection example:

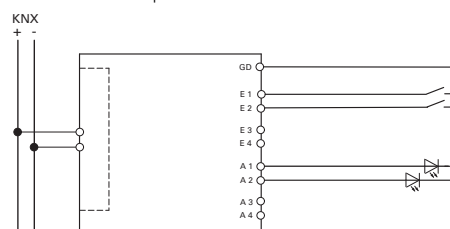

### Colour coding of the incoming cables

GD	grey:	Reference potential (GD)
E1	blue:	Input 1
E2	brown:	Input 2
E3	green:	Input 3 *
E4	red:	Input 4 *
A1	white/blue:	Output 1
A2	white/brown:	Output 2
A3	white/green:	Output 3 *
A4	white/red:	Output 4 *

\* (only art. no. MTN670804)




#### WARNING


##### Risk of fatal injury from electrical current.

##### The device could be damaged.

Safety clearance must be guaranteed in accordance with IEC 60664-1. There must be at least 4 mm between the individual cores of the 230 V supply cable and the KNX line.



- Connect the bus wires to the bus connecting terminal.



- Connect the bus terminal to the bus connection (A).

## Putting push-button interface into operation

- Press the programming button.

The programming LED lights up.

- Load the physical address and the application into the device from the ETS.

The application was loaded successfully, the device is ready for operation.

## Technical data

Initialisation:	The push-button interface is only ready for operation after at least 17 seconds after a bus voltage failure or a bus reset.
Power supply from bus:	DC 24 V / < 10 mA
Inputs	
Use:	connection of floating contacts
Contact resistance:	< 500 $\Omega$ (with closed contact)
Outputs	
Use:	connection of low-current LEDs (< 1 mA)
Contact voltage $V_k$ :	< 3 V (SELV)
Contact current:	< 0.5 mA
Ambient temperature	
Operation	-5 °C to +45 °C
Storage	-25 °C to +55 °C
Transport	-25 °C to +70 °C
Max. humidity:	93 % relative humidity, no moisture condensation
Environment:	The device is designed for use at a height of up to 2000 m above sea level (MSL).
Protection class:	II
Type of protection:	IP 20
Connections	
Inputs, outputs:	
Art. no. MTN670802	each 2 and GD, single-core
Art. no. MTN670804	each 4 and GD, single-core
Maximum cable length:	7.5 m

## Schneider Electric Industries SAS

If you have technical questions, please contact the Customer Care Center in your country.

[www.schneider-electric.com](http://www.schneider-electric.com)

This product must be installed, connected and used in compliance with prevailing standards and/or installation regulations. As standards, specifications and designs develop from time to time, always ask for confirmation of the information given in this publication.